



50X1-HUM



~~44~~ Voltage and Transformer Chart
of North Korea


Chonyok Choryu-to
Office of Electric Power, Bureau of Industry
Ministry of Industry, North Korea, P'yongyang
1948




50X1-HUM

1948

NK VOLTAGE AND TRANSFO

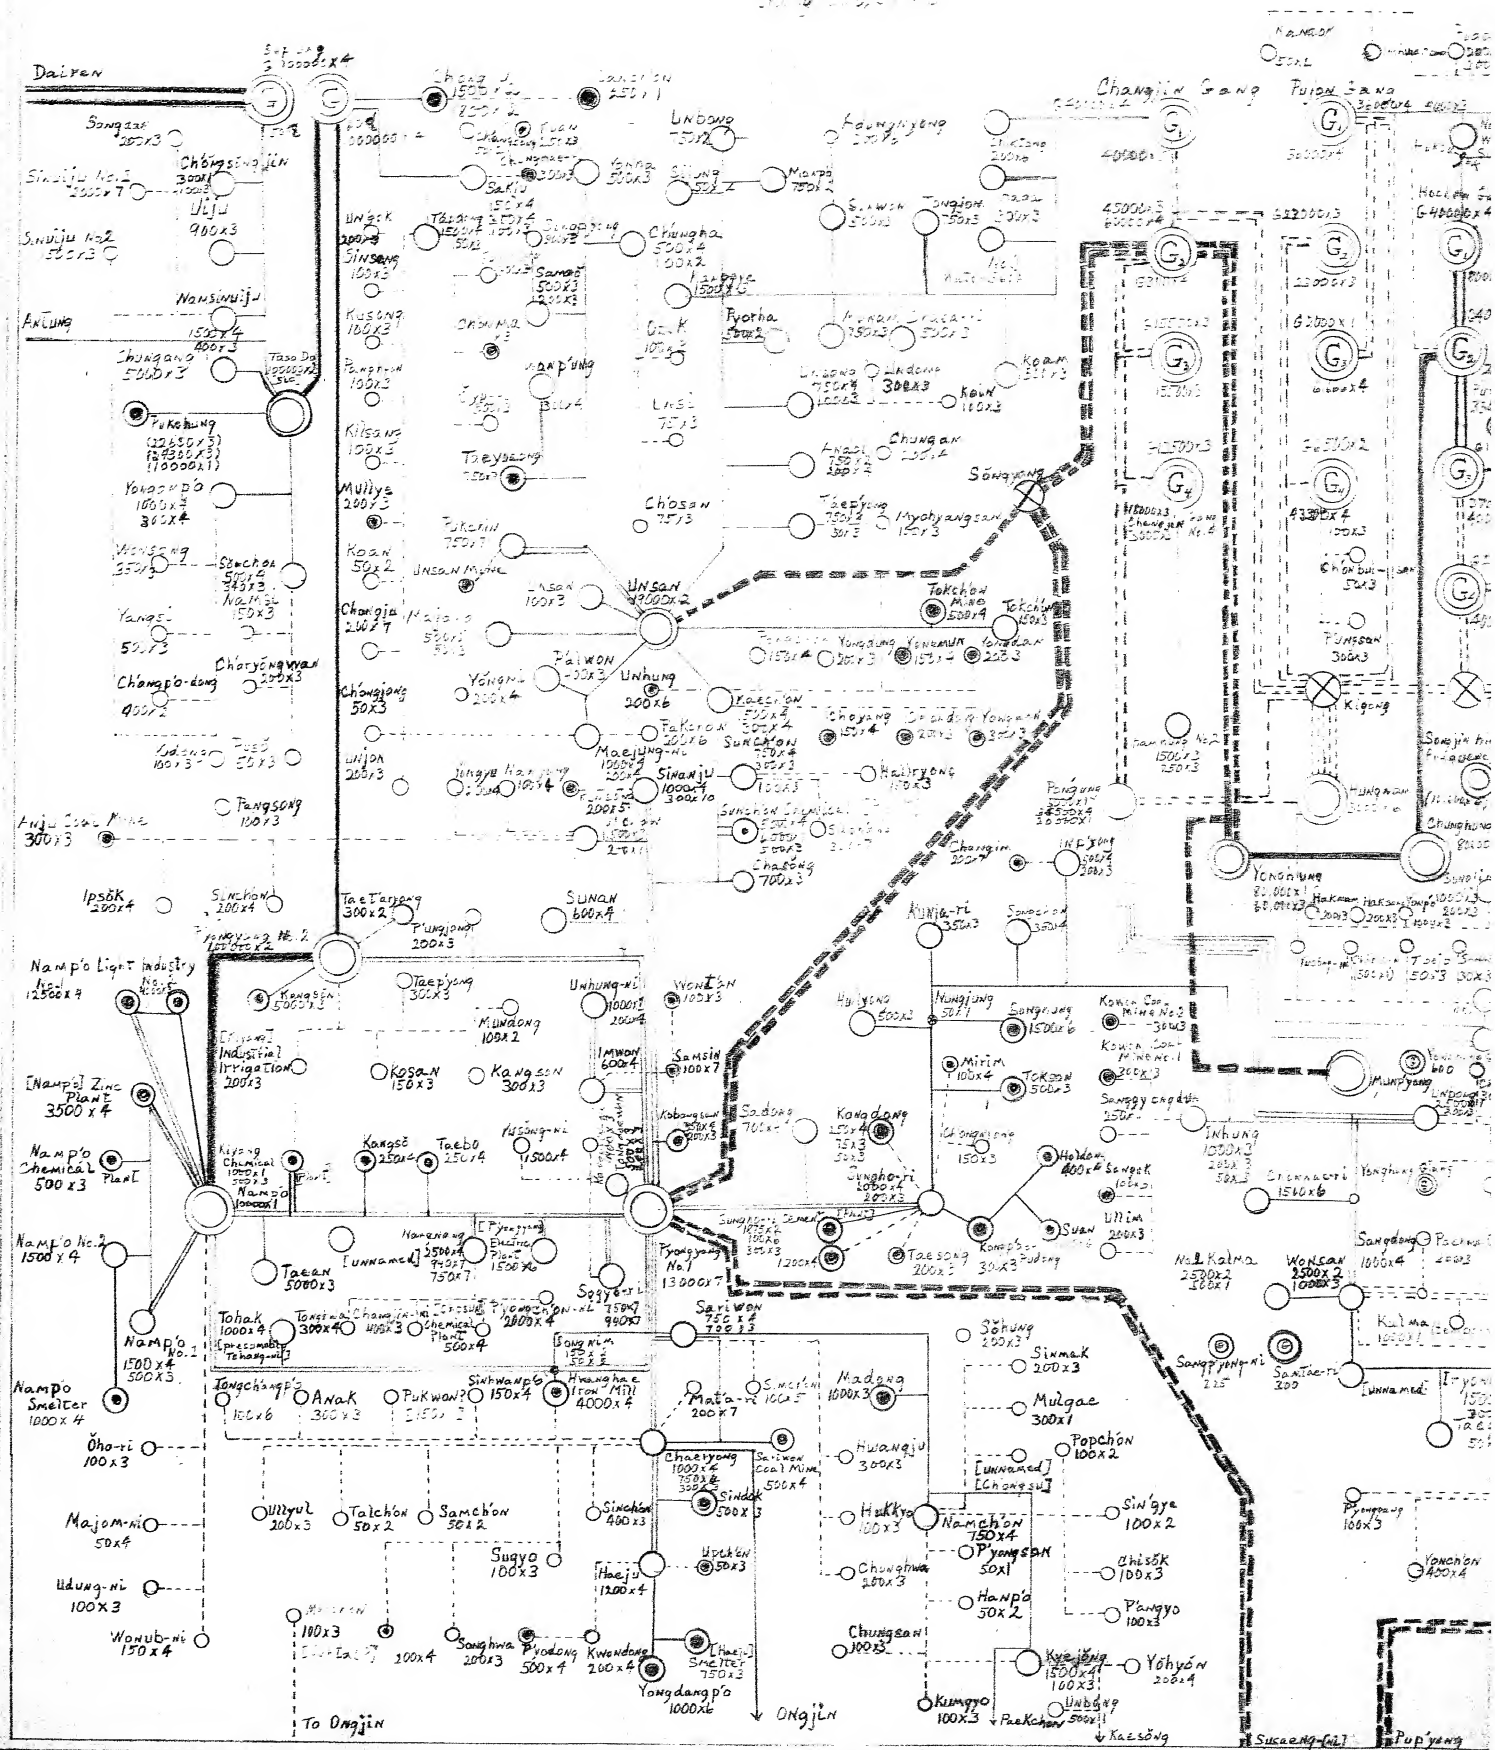

TRANSFORMER CHART

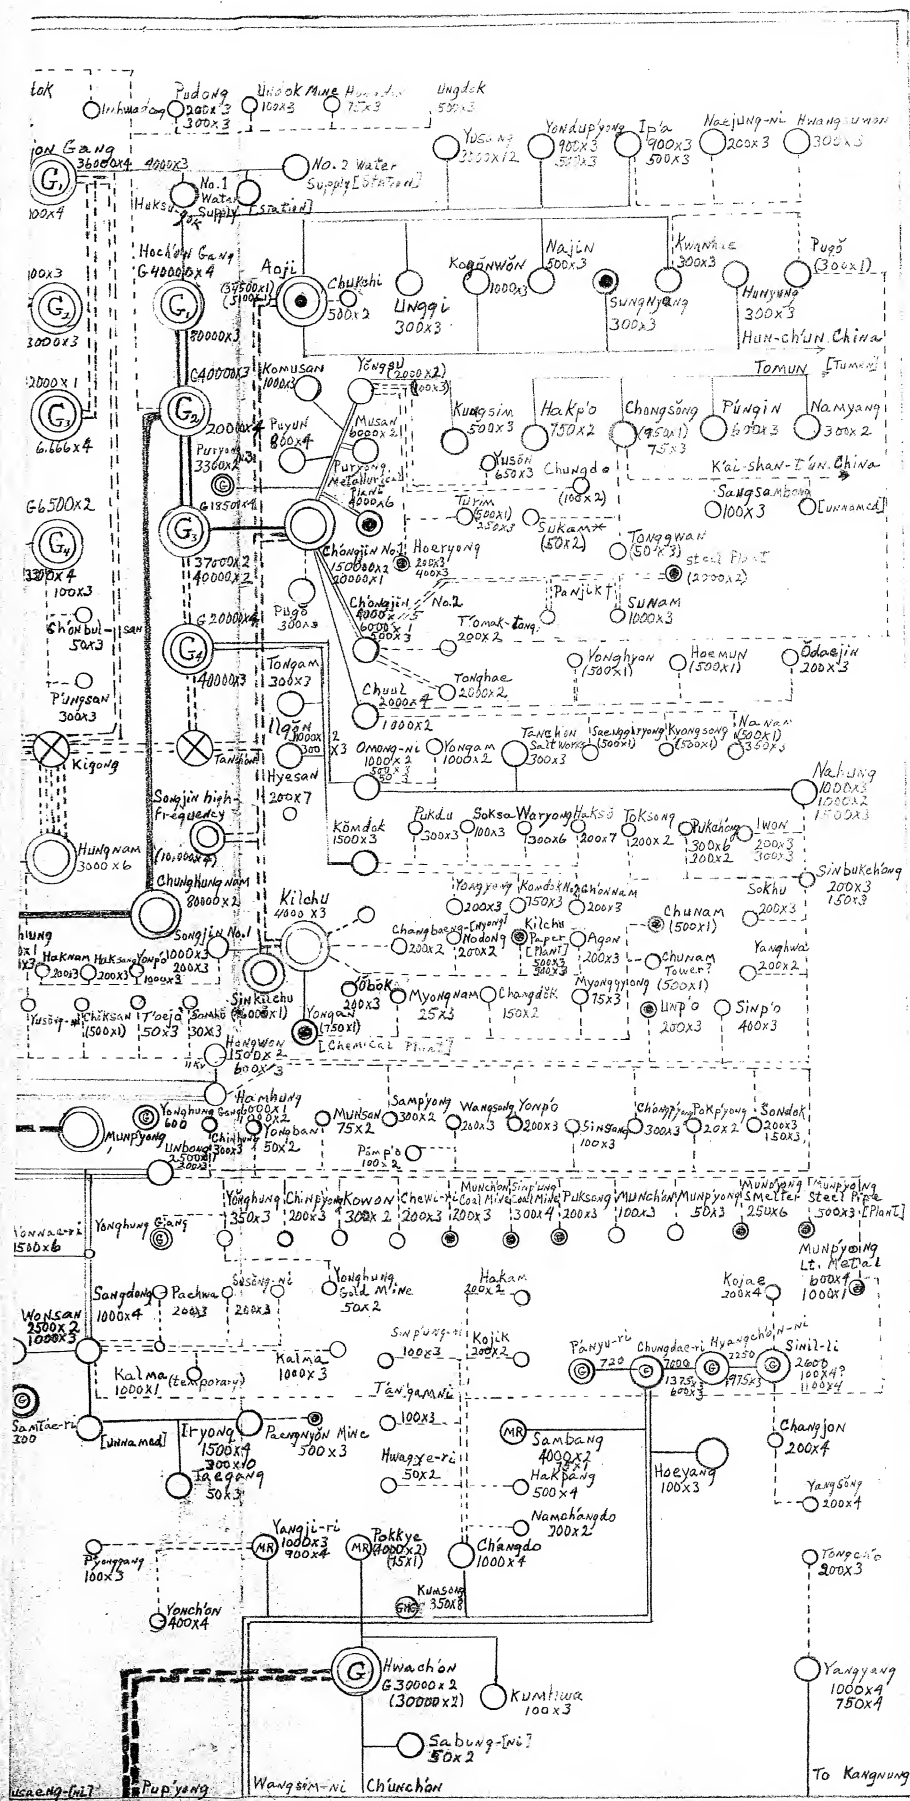

LEGEND

⊙	[Illegible] transformer station
○	Transformer station
⊗	Switch station
—	220 KV transmission line
---	154 " "
---	110 " "
---	66 " "
---	44 " "
---	22 " "
G	Generator
123x5	KVA and number of transformers [including those in reserve]
()	Three-phase transformer
MG	Motor generator
MR	Mercury-vapor rectifier
—	Indicates information written with pencil

* Sukam - China's coal and iron ore loading station
 송암 항만은 중국과 만주국과의 무역을 위한 시설이다.
 만주국 방면

+ Panjuk - China's coal and iron ore loading station
 남포항은 만주국과 중국과의 무역을 위한 시설이다.
 만주국 방면
 No figures are given with this pencil

100.0x3